

**ADDENDUM
(AD)**

PROJECT: Nebraska Department of Correctional Svcs
Community Correctional Center – Lincoln
Fire Alarm Replacement
2720 West Van Dorn Street
Lincoln, Nebraska

AD NO.: 1

DATE: January 3, 2019

NDCS PROJECT NO.: 1820

DDI PROJECT NO.: 18-0157

ISSUED BY: Jon Dalton, Electrical Engineer

This addendum is issued by the Architect to all known bidders before receipt of proposals, for the purpose of explaining, interpreting, or modifying the original plans and specifications. When enumerated by the bidder upon the proposal sheet, the information or instructions given hereon will be equally binding upon all parties as if included in the original plans and specifications.

BIDDER MUST ENTER THE NUMBER OF THIS ADDENDUM ON HIS PROPOSAL SHEET

THE FOLLOWING ITEMS ARE APPLICABLE TO THE SPECIFICATIONS:

AD-1, ITEM 1:

In reference to the **NOTICE TO BIDDERS**, make the following changes:

Revise the due date for BIDS to be JANUARY 31, 2019 at 2:00 pm.


Revise the PRE-BID CONFERENCE date to be JANUARY 17, 2019 beginning at 10:00 am.

THE FOLLOWING ITEMS ARE APPLICABLE TO THE DRAWINGS:

AD-1, ITEM 2:

In reference to **Sheet E-102 – MAIN BUILDING – FIRE ALARM NEW**, see attached Supplemental Drawing E-102.1 for revisions.

END AD-1

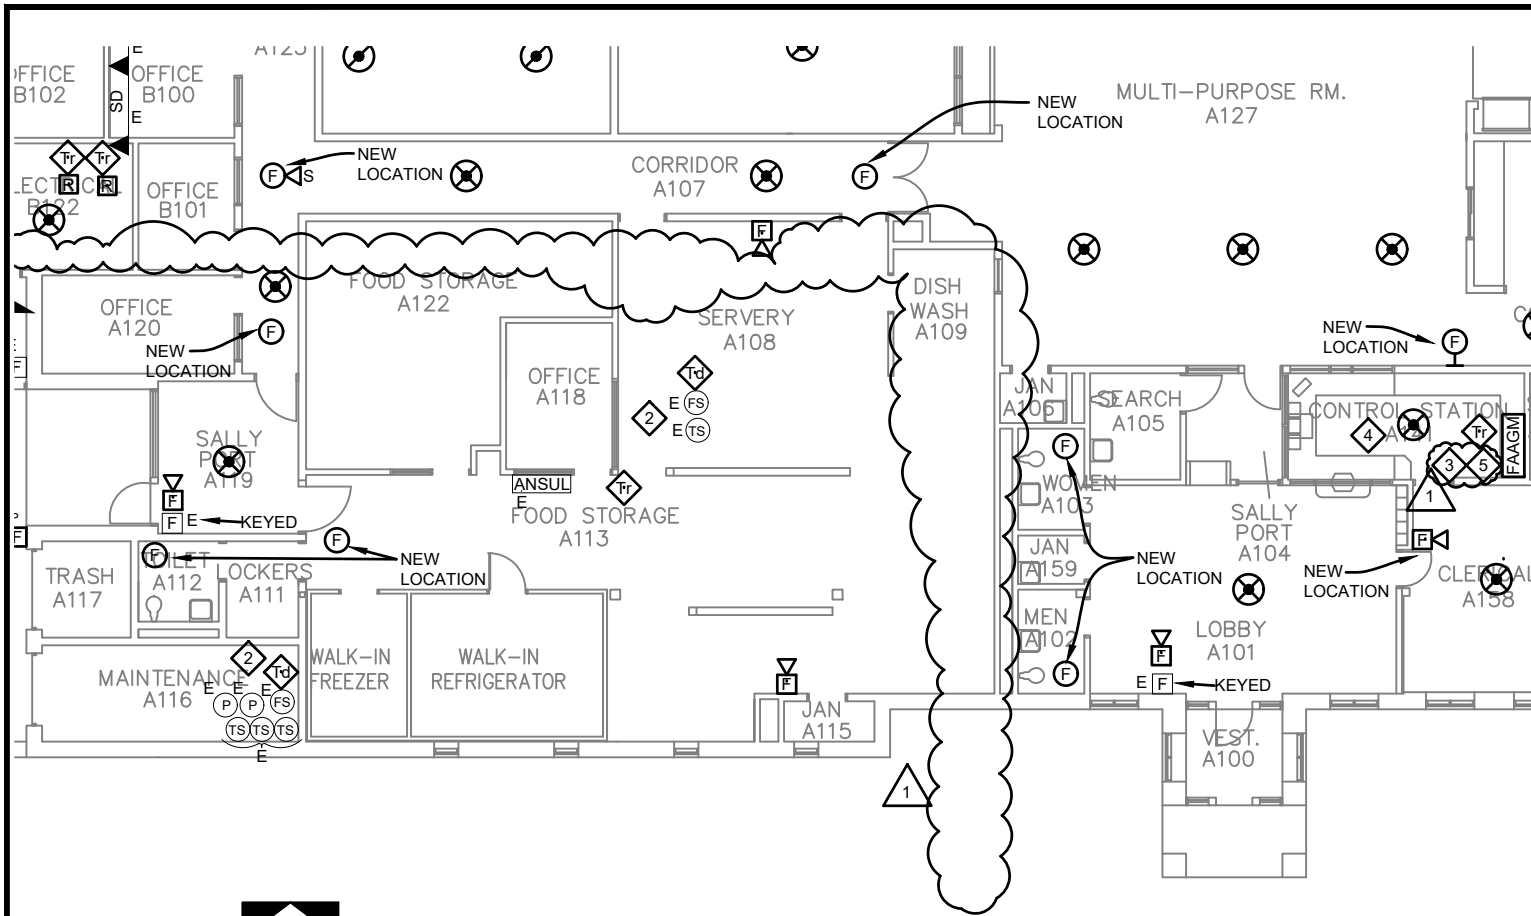


1 PARTIAL MAIN BUILDING - FIRE ALARM NEW


SCALE: 1/16" = 1'-0"

1 ELECTRICAL KEYED NOTES

- 1 RECONNECT FIBER TO NEW SIEMENS CERBERUS PRO FIRE ALARM PANEL IN THIS BUILDING. FIBER IS COMING FROM 160 BED BUILDING SIEMENS CERBERUS PRO FIRE ALARM PANEL FOR INTERCONNECTION BETWEEN BOTH BUILDING FIRE ALARM PANELS.
- 2 RECONNECT SPRINKLER SYSTEM FLOW AND TAMPER SWITCHES AND PRESSURE VALVES TO NEW FIRE ALARM PANEL. PROVIDE ADDRESSABLE MODULES FOR CONNECTION.
- 3 PROVIDE NEW UPDATED FIRE ALARM ANNUNCIATOR GRAPHIC MAP AND CONNECT TO NEW FIRE ALARM SYSTEM. INSTALL NEW GRAPHIC MAP OVER OLD LOCATION. PROVIDE ADDITIONAL CABLING IN CONDUIT AS NEEDED FOR CONNECTION TO NEW FIRE ALARM PANEL.



- 4 CONNECT EXISTING EXTERIOR DOOR RELEASE BUTTON LOCATED IN CONTROL ROOM TO NEW FIRE ALARM PANEL. REUSE EXISTING CABLING RUNNING FROM EXISTING RELEASE BUTTON TO NEW FIRE ALARM PANEL LOCATED AT OLD FIRE ALARM PANEL SPACE.



- 5 PROVIDE A DEDUCT ALTERNATE TO EXCLUDE THE INMATE ROOM SMOKE DETECTORS FROM THE FIRE ALARM ANNUNCIATOR GRAPHIC MAP.

1 01-03-2019 FIRE ALARM CHANGES

Lincoln
 1221 N Street, Suite 600
 Lincoln NE 68508
 Phone 402-476-9700
 Fax 402-476-9722
 Vermillion
 15 East Main, Suite 201
 Vermillion SD 57069
 Phone 605-624-1081

davis

design

Client Information
NDCS - CCCL

Lincoln, Nebraska

Project Information
Fire Alarm System Replacement

Issue Date	01-03-2019
Job #	18-0157
Drawn by:	DCT
CADD file:	

COPYRIGHT © DAVIS DESIGN ALL RIGHTS RESERVED

Drawing Title
Fire Alarm Changes

From Sheet: **E-102** for CA use:

Drawing #
E-102.1