



Date: 11 March 2019 Date of Issuance: 20 December 2018
Project Name: Lincoln Correctional Center Fire Sprinkler Upgrade Date of Opening: 19 March 2019
FE Project No.: 182029

NOTICE: This addendum is applicable to the referenced project and is issued to all known planholders prior to receipt of proposals. The information contained herein shall be fully incorporated into the Bid Contract Documents as though originally incorporated. Failure to acknowledge all amendments may be cause for rejection of the bid.

TO: Bidders and Others Concerned

Changes to the Project Manual

1. SPECIFICATION 02 30 00 – EARTHWORK:
 - A. Delete this section in its entirety. All site work associated with this project will be provided by a separate contract.
2. SPECIFICATION 21 05 00 – FIRE PROTECTION:
 - A. Page 15, section 3.10.A, revise first sentence of this paragraph to delete "both underground fire main and". After the first sentence add the following: **"Separate contract that is providing new underground fire mains for each facility will flush new underground mains per NFPA 24 guidelines and provide copy of certification of flushing to this project's primary contractor prior to connection to new underground piping."**
3. SPECIFICATION 26 05 00 – GENERAL ELECTRICAL:
 - A. Page 3, section 1.9.B: Change dollar values in last sentence to read \$400 for up to eight (8) sheets and \$25.00 per sheet for each additional requested drawing.
4. SPECIFICATION 32 92 00 – GRASSES:
 - A. Delete this specification in its entirety. Site work to be done by separate contract.
5. SPECIFICATION 33 05 26 – LOCATE WIRE FOR ALL NON-ELECTRIC SYSTEMS:
 - A. Delete this specification in its entirety. Site work to be done by a separate contract.

Changes to the Drawings

1. Fx200 – LCC COMPOSITE LEVEL ONE FIRE SUPPRESSION PLAN:
 - A. Add the following to the end of General Keynotes Number 1: “WHERE NECESSARY TO ROUTE PIPING FROM SPACE BELOW WALKWAY TO UPPER LEVEL OF WALKWAY, PROVIDE 16 GAUGE STEEL PROTECTION FROM FLOOR LEVEL TO A HEIGHT OF 7'-2" ABOVE FINISHED WALKWAY TO PROTECT PIPING FROM DAMAGE. PIPE PROTECTIVE COVER SHALL BE SECURED TO THE WALL USING LAG BOLTS SIMILAR TO WHAT IS SHOWN IN ATTACHED PHOTOGRAPH. SEE ATTACHED PHOTOGRAPH FOR EXAMPLE OF PROTECTION EXPECTATIONS.

2. FA101 – LCC & DEC FIRE ALARM PLANS:
 - A. General Electrical Notes: Add Note B stating the following: AT ALL ELEVATOR LOCATIONS THAT SPRINKLERS ARE BEING ADDED TO ELEVATOR PITS AND/OR ELEVATOR MACHINE ROOMS, PROVIDE MODIFICATIONS TO EXISTING SYSTEM IN ORDER TO PROVIDE SHUNT TRIP ACTIVATION OF ELEVATOR(S). PROVIDE A CONNECTION TO THE FIRE ALARM PANEL TO GENERATE A SUPERVISORY SIGNAL AT FIRE ALARM CONTROL PANEL AND REMOTE ANNUNCIATORS UPON ACTIVATION OF SHUNT TRIP. COORDINATE CONNECTION REQUIREMENTS WITH EXISTING ELEVATORS AND AUTHORITY HAVING JURISDICTION.

Clarifications

- A. Verification: Per Nebraska state elevator inspector, no additional smoke or heat detection required in pit of elevators due to addition of fire sprinklers.

Attachments


1. PRE-BID MEETING SIGN-IN SHEET.
2. PHOTOGRAPH OF STEEL PIPE PROTECTION.

Miscellaneous

- 1.

-- END --

FE #182029 Addendum No. 1 - Rebid

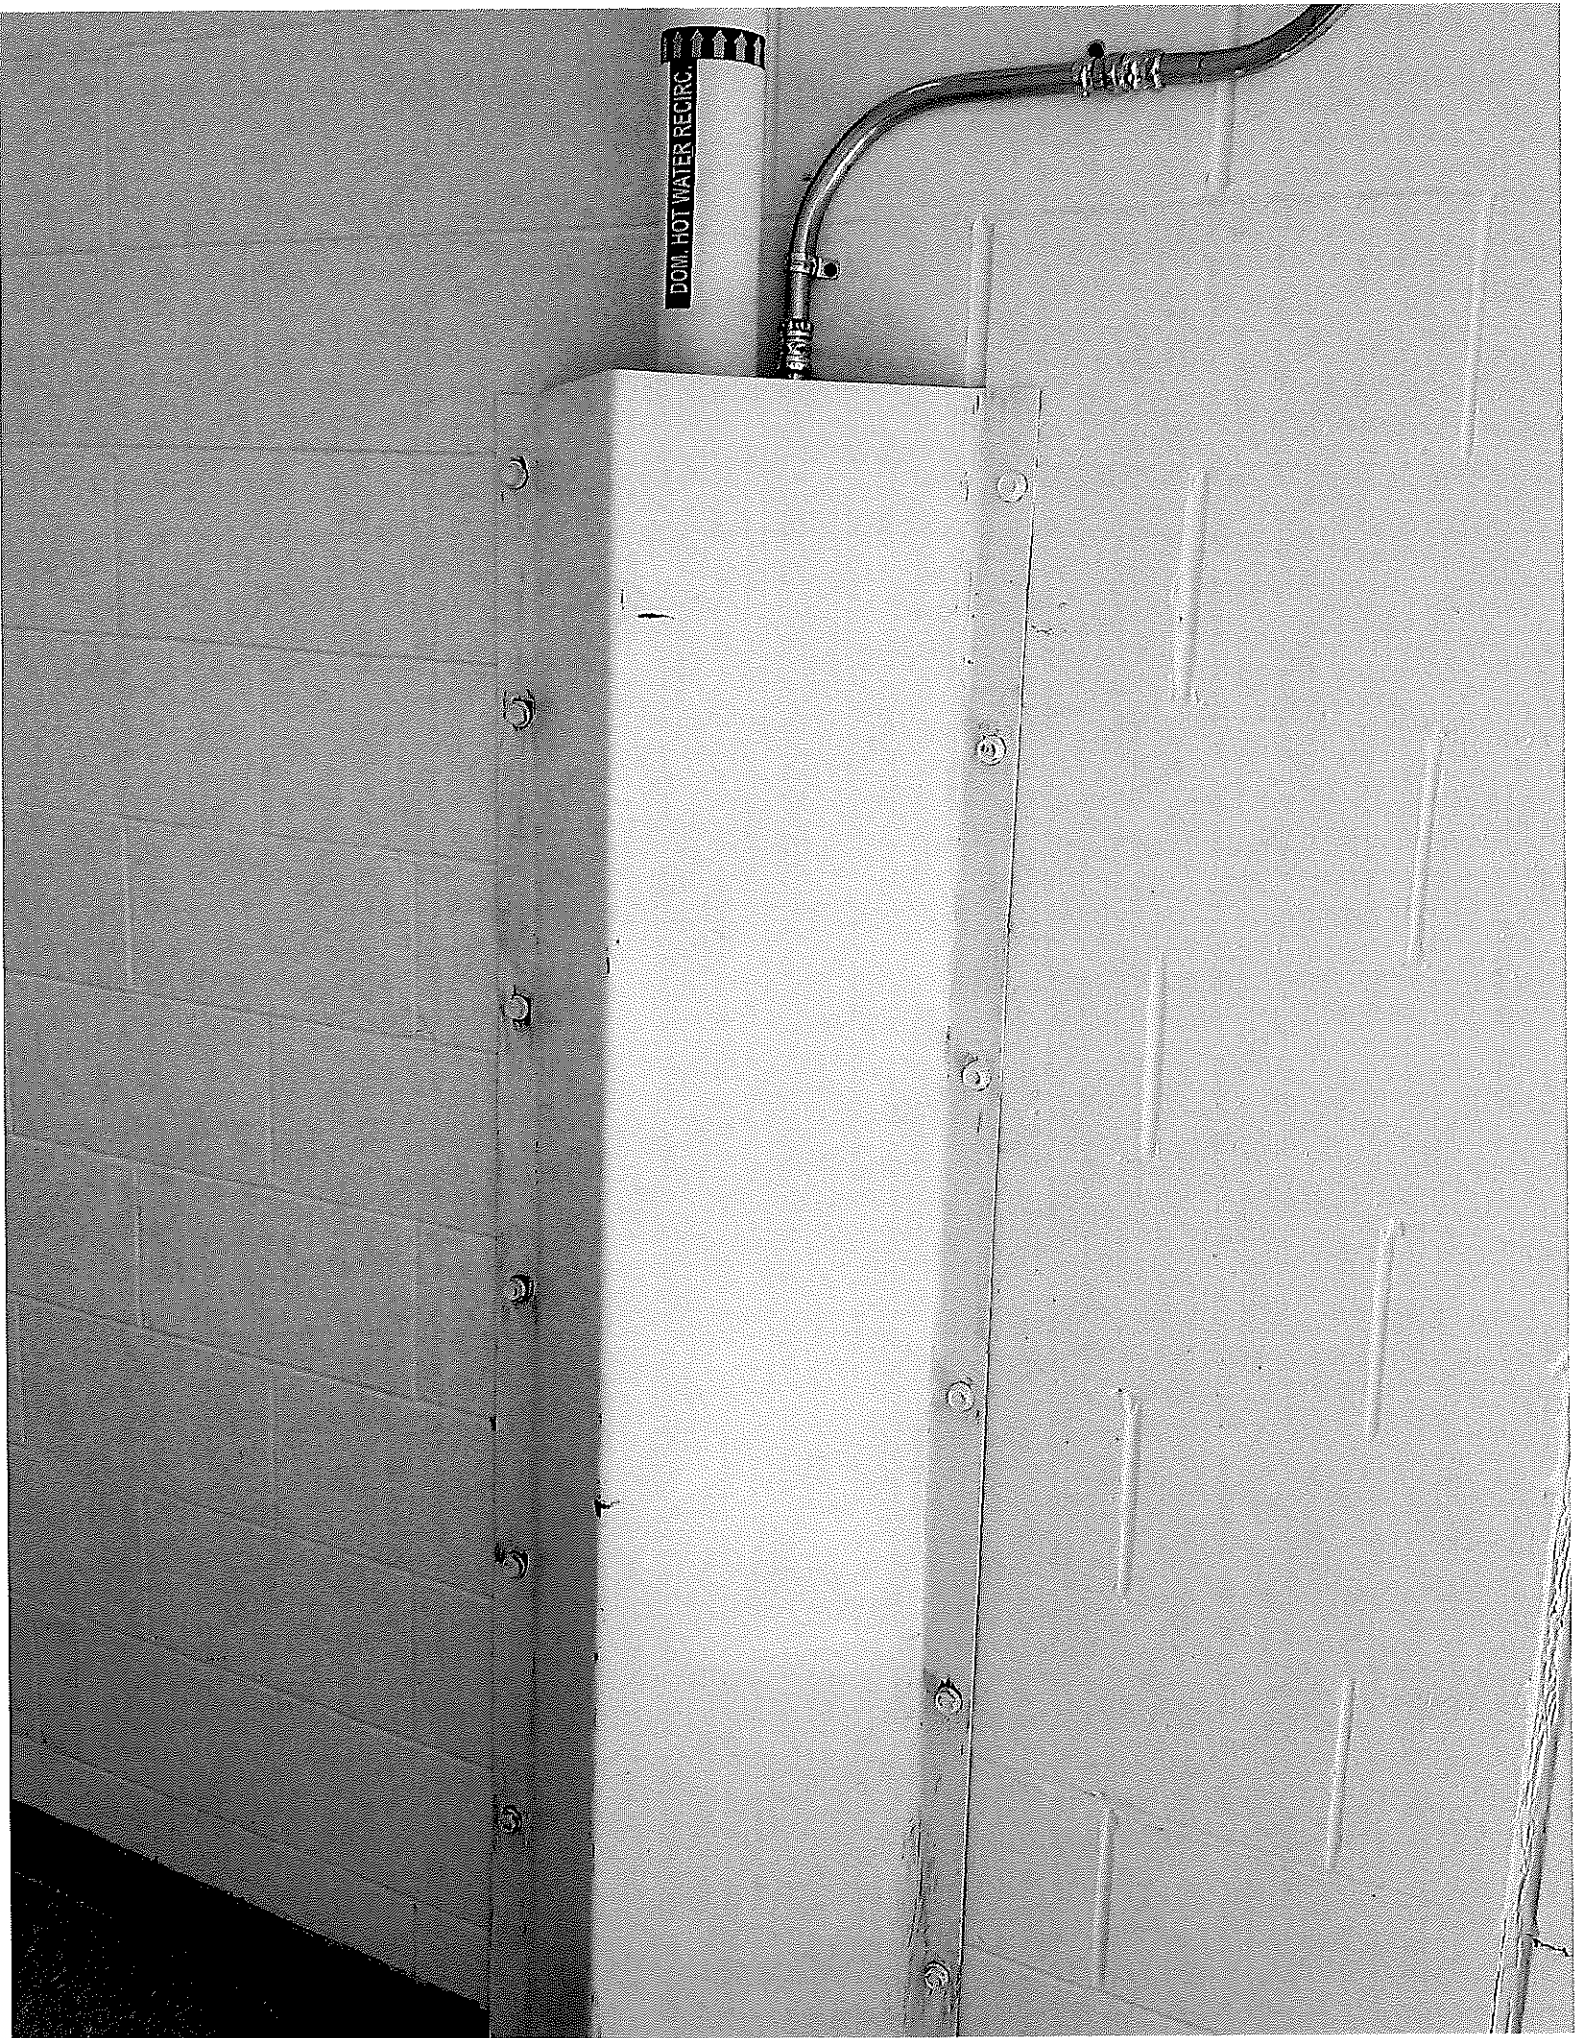

DOW HOT WATER RECIRC.

Sign-In Sheet

Project: Fire Suppression Upgrade Project #: 1802
 Facility: LCC/DEC
 Project Leader: Josh Andrew
 Meeting Location: Lincoln Correctional Center

Date: 06/04/2019 Time: 1000hrs
 Pre-Bid Conference Pre-Construction Conference
 Other: _____

	Name	Organization	Office Phone	Email
1.	Josh Andrew	NDCS	402 479-5815	Josh.andrew@nebraska.gov
2.	Rod Anderson	NDCS	402 479-5742	Rodney.anderson@nebraska.gov
3.	Chris MEINIKER	MFP	402 466 2616	CHRIS@MFP-INC.COM
4.	Kurt Daberkow	Brester Const.	402-423-2337	Kurtd@bresterconstruction.com
5.	James Jansen	NDCS - DEC	402-479-6339	James.jansen@nebraska.gov
6.	Rich Hildreth	NDCS LCC	402-479-6139	rich.hildreth@nebraska.gov
7.	Doug Diltz	DEC	402-479-6309	Doug.Diltz@nebraska.gov
8.	Rick Wilson	LCC/DEC	402-479-6138	rick.wilson@nebraska.gov
9.	James Francis	LCC	402 479-6153	James.Francis@nebraska.gov
10.	DONNA KOTLAN	LCC	402-330-5900	dkotlan@Parsons.com
11.				
12.				
13.				
14.				